



Temporary Construction Trailers


Electrical Requirements

NEC 545 Part II Relocatable Structures

NEC 545.24(A) A single disconnecting means shall be provided at a readily accessible location



NEC 545.22(A) Feeder shall include 4 colored insulated conductors or be part of a listed cable assembly

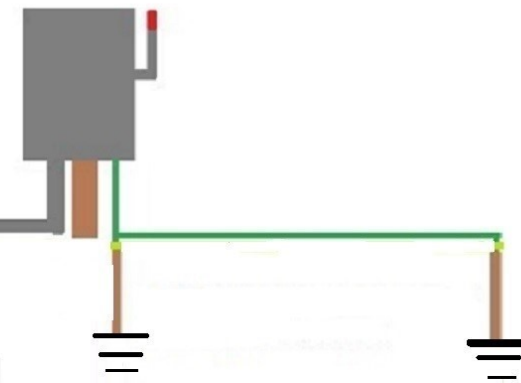

NEC 250.53(A)(2) Two ground rods 6 feet apart

NEC 545.26 Bond the metal frame of the trailer to the ground bar and separate neutrals and grounds in panel

NEC 590.4(J) Cables used as feeders shall not be installed on the ground and shall be protected from physical damage