

COMMERCIAL PIPE CONNECTION ABANDONMENT – PARTIALLY LINED TUNNEL, STD PLATE 2601


NOTES:

1. REFER TO STANDARD SPECIFICATIONS FOR CONSTRUCTING AND REPAIRING PRIVATE SEWER CONNECTIONS FOR FURTHER INFORMATION AND DETAILS. IF THERE ARE CONFLICTS BETWEEN THE SPECIFICATION AND STANDARD PLATE, THE STANDARD PLATE GOVERNS.
2. THIS PLATE IS FOR STORM OR SANITARY CONNECTION ABANDONMENTS FOR COMMERCIAL PROPERTIES.
3. CONTRACTOR TO SUBMIT A AND B TO CITY TWO WEEKS BEFORE CONSTRUCTION, AND C POST CONSTRUCTION:
 - A. WORK PLAN AND SCHEDULE.
 - B. MATERIAL SHOP DRAWINGS AND SPECIFICATIONS.
 - C. POST-CONSTRUCTION PHOTOS SHOWING ALL PIPE, BULKHEADS, AND CONNECTIONS.

I hereby certify that this plan, specification or report was prepared by me or under my direct supervision and that I am a duly Licensed Professional Engineer under the laws of the State of Minnesota

Aaron D. Hass
AARON D. HASS

Date 05-10-2024 Lic. No. 26424

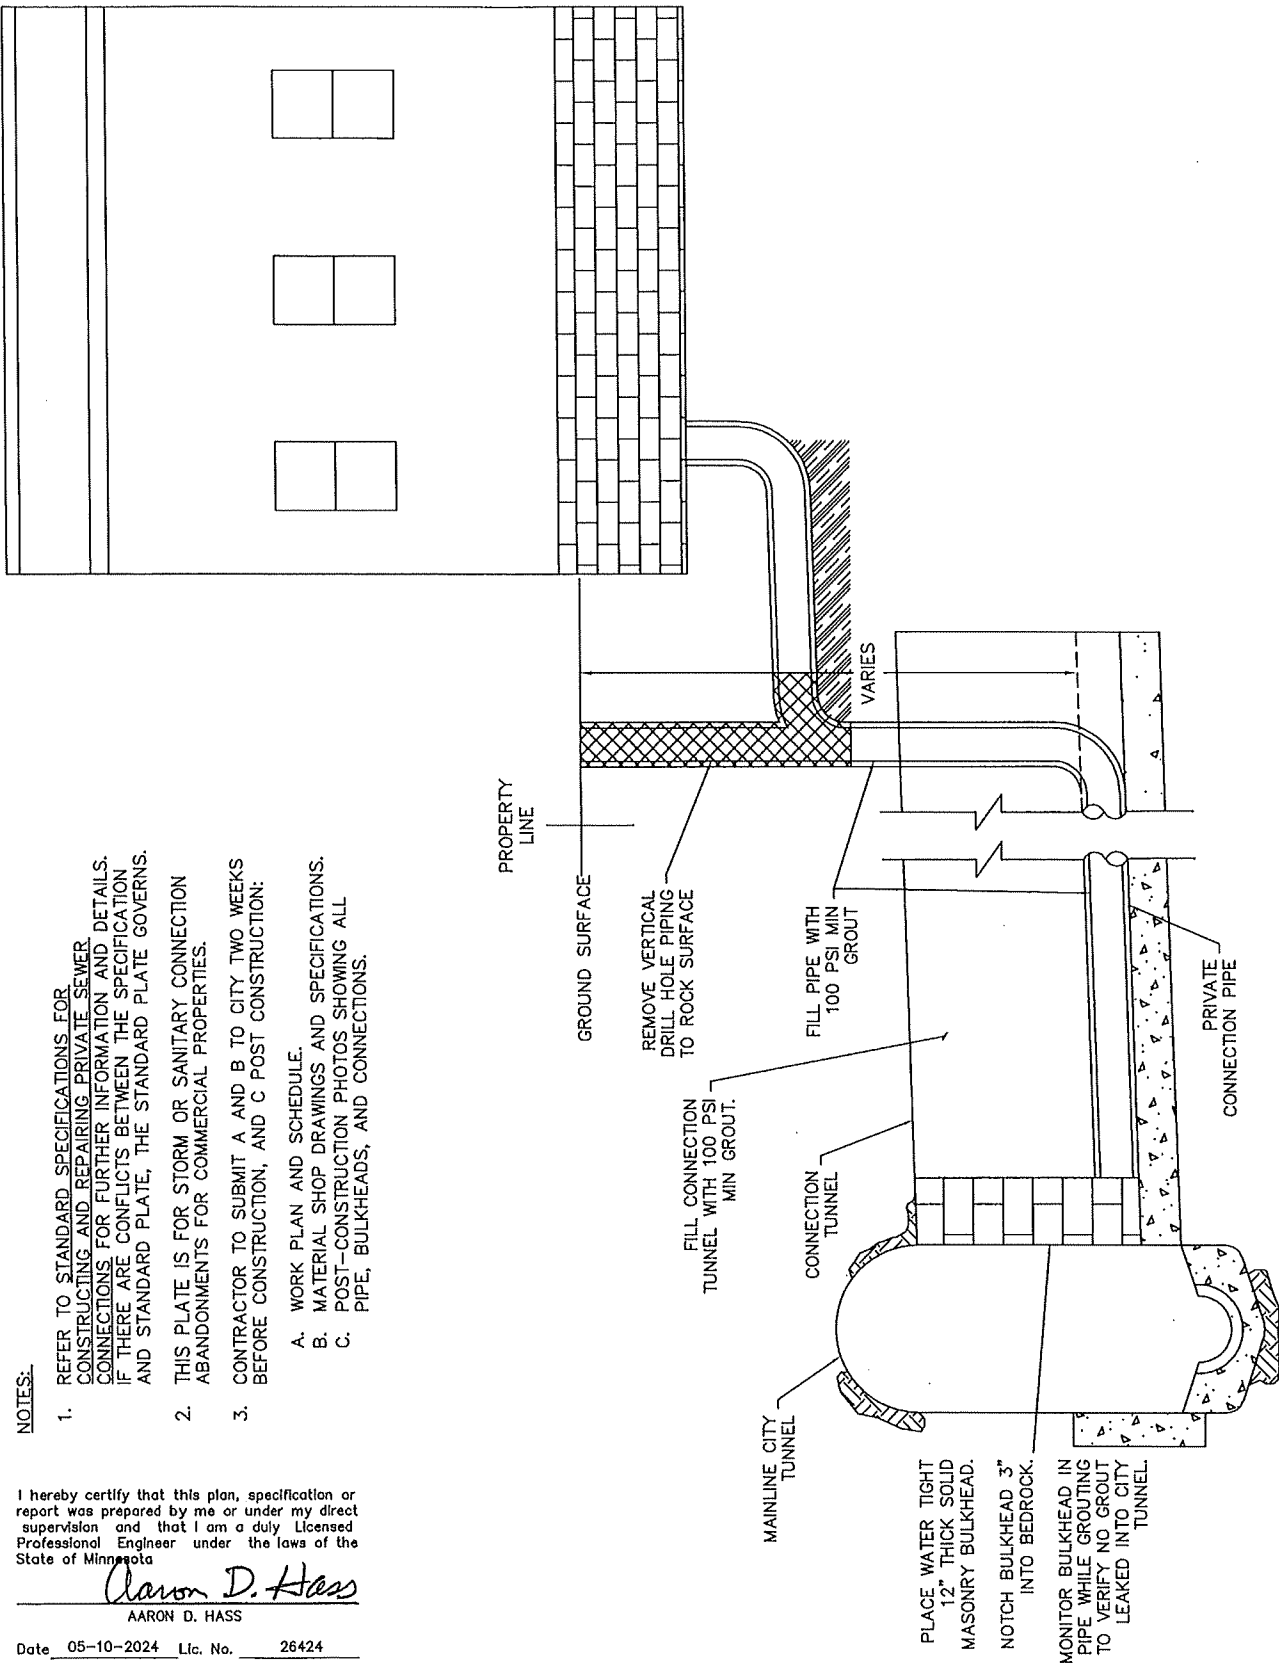

PLACE WATER TIGHT 12" THICK SOLID MASONRY BULKHEAD.
NOTCH BULKHEAD 3" INTO BEDROCK.
MONITOR BULKHEAD IN PIPE WHILE GROUTING TO VERIFY NO GROUT LEAKED INTO CITY TUNNEL.

APPROVED
Nick Petri
CITY ENGINEER

CITY OF ST. PAUL
DEPARTMENT OF PUBLIC WORKS
COMMERCIAL PIPE CONNECTION ABANDONMENT
PARTIALLY LINED TUNNEL

Date of Revision
MAY 2024

Standard Plate No.
2601