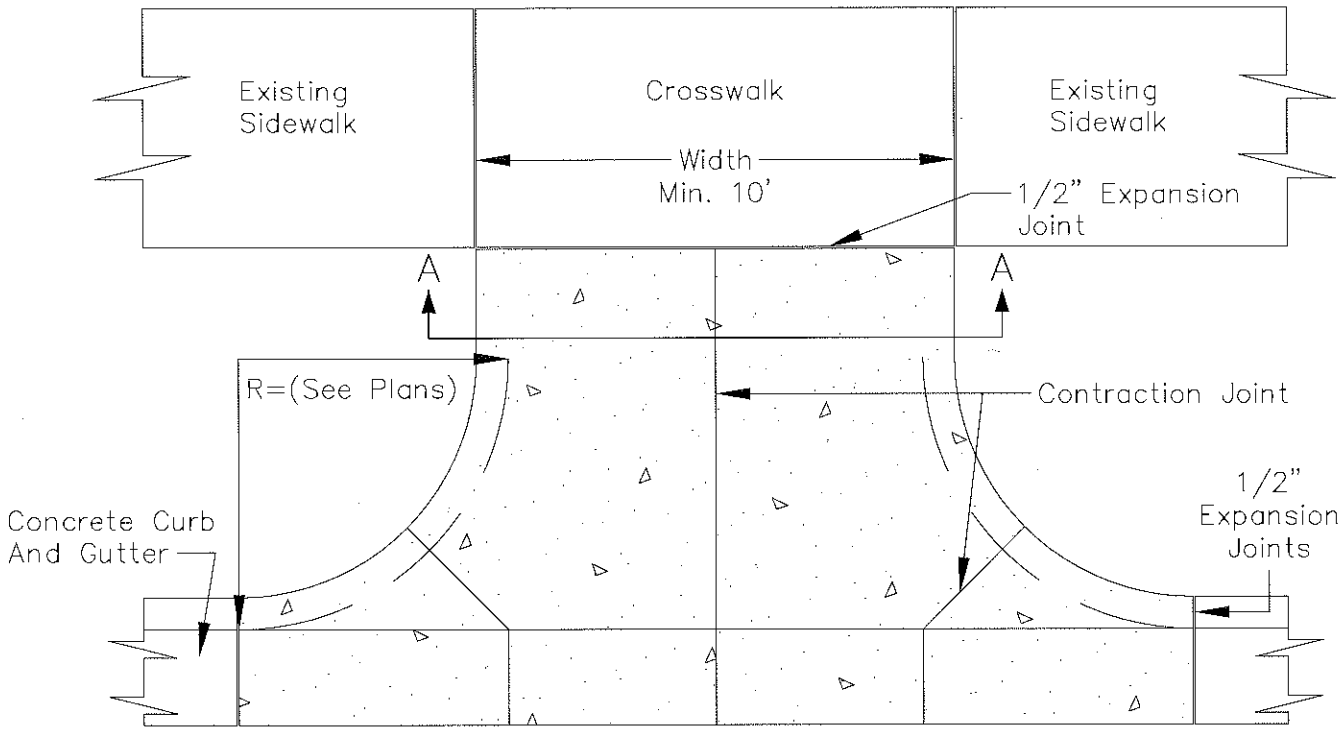

PLAN

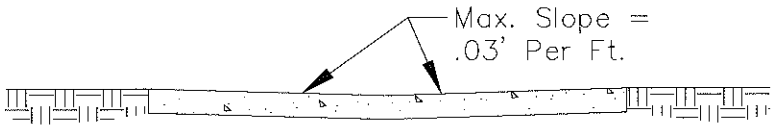

SECTION A–A
(For Alleys)

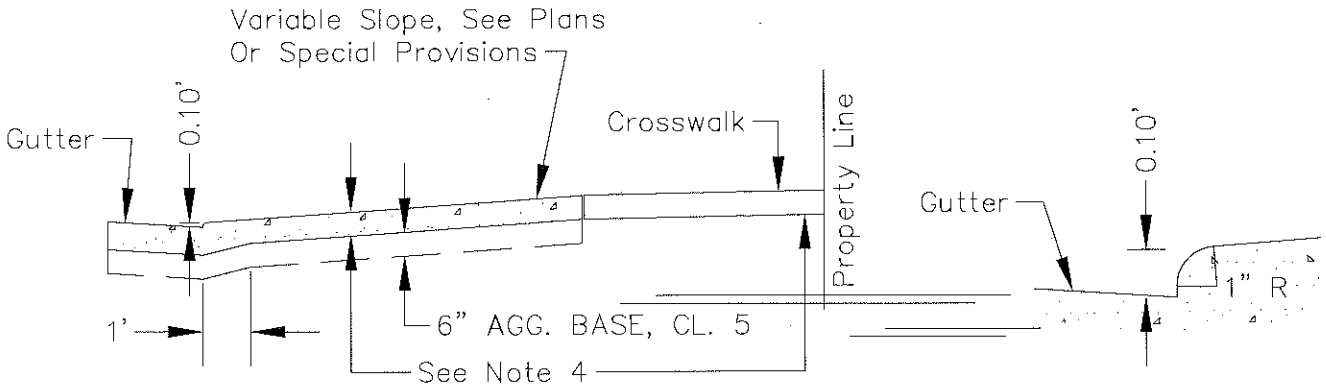

SECTION ON ℄ DRIVEWAY

DETAIL OF LIP

1. Panel Width Shall Not Exceed 10' Without A Centerline Contraction Joint.
2. Driveway To Be One Course Concrete Pavement, Mix No. 3F52.
3. Gutter To Be Paved Integral With Driveway Pavement.
4. 6" Thick For Residential, 8" Thick For Commercial Drive And Alleys.

I hereby certify that this plan, specification or report was prepared by me or under my direct supervision and that I am a duly Licensed Professional Engineer under the laws of the State of Minnesota

DANIEL A. HAAK

DANIEL A. HAAK

Date 11/25/15 Lic. No. 17274

APPROVED CITY ENGINEER	CITY OF ST. PAUL DEPARTMENT OF PUBLIC WORKS CONCRETE DRIVEWAY TYPE 1	Date of Revision NOV 2015	Standard Plate No. 1200D