


PLAN

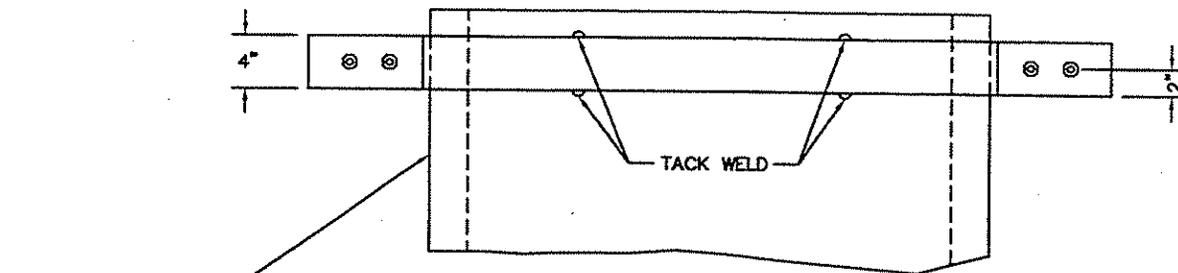

ELEVATION

NOTES:

1. TYPE AND SIZE OF STANDPIPE AS SHOWN ON PLANS.
2. STEEL STRAPS SHALL BE BENT TO FIT SNUGLY AROUND STANDPIPE.
3. TACK WELD STRAPS TO STANDPIPE AT MINIMUM OF 4 EQUALLY SPACED LOCATIONS ON BOTH TOP AND BOTTOM OF STRAPS.
4. STEEL STRAP SHALL MEET ASTM A-242 FOR HIGH STRENGTH, LOW ALLOY, STRUCTURAL STEEL.

I hereby certify that this plan, specification or report was prepared by me or under my direct supervision and that I am a duly Licensed Professional Engineer under the laws of the State of Minnesota

*Joseph J. Mueller*  
 JOSEPH J. MUELLER  
 Date 9-2-02 Lic. No. 13942

APPROVED \_\_\_\_\_  
*Joseph J. Mueller*  
 CITY ENGINEER

CITY OF ST. PAUL  
 DEPARTMENT OF PUBLIC WORKS  
 ANCHOR CLAMP DETAIL

Date of Revision  
 JULY 2002

Standard Plate No.  
 2311B