



Temporary Construction Trailers


NEC 550.4 Mobile home not intended as dwelling



NEC 550.32
Maximum 30'
and within sight
not mounted
on trailer



NEC 230.66 Service rated disconnect

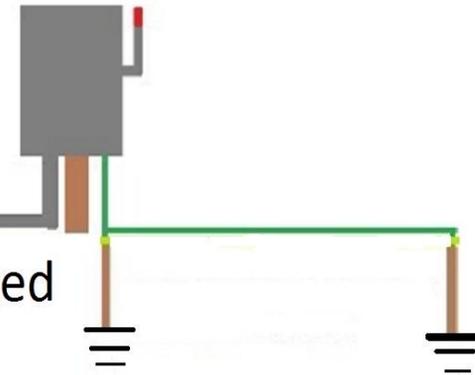

NEC 550-33 Four insulated colored conductors

NEC 550.16 Separate neutrals from grounds and bond trailer frame to equipment ground bar in panel

NEC 250.53(A)(2) Two ground rods 6 feet apart

NEC 590.4(J) Cables used as feeders or branch circuits shall not be on the ground or floor