


NOTES:

1. REINFORCING STEEL TO BE GRADE 60 FUSION BONDED EPOXY COATED PER ASTM A775
2. MINIMUM CLEAR DISTANCE TO REBAR=1"
3. REMOVE ALL FORMWORK FROM INTERIOR OF CATCH BASIN
4. FOR USE WITH INTEGRAL CURB & WALK
5. TO BE USED ONLY WHERE MAJOR UTILITY CONFLICT PROHIBITS USE OF TYPE 7A OR 7B CATCH BASIN
6. IN LIEU OF BLOCK CONSTRUCTION, 8" THICK FORM AND POURED CONCRETE WALLS CAN BE USED AT THE DIRECTION OF THE ENGINEER.

I hereby certify that this plan, specification or report was prepared by me or under my direct supervision and that I am a duly Licensed Professional Engineer under the laws of the State of Minnesota

Aaron D. Hass
AARON D. HASS

Date 1-21-2026 Lic. No. 26424

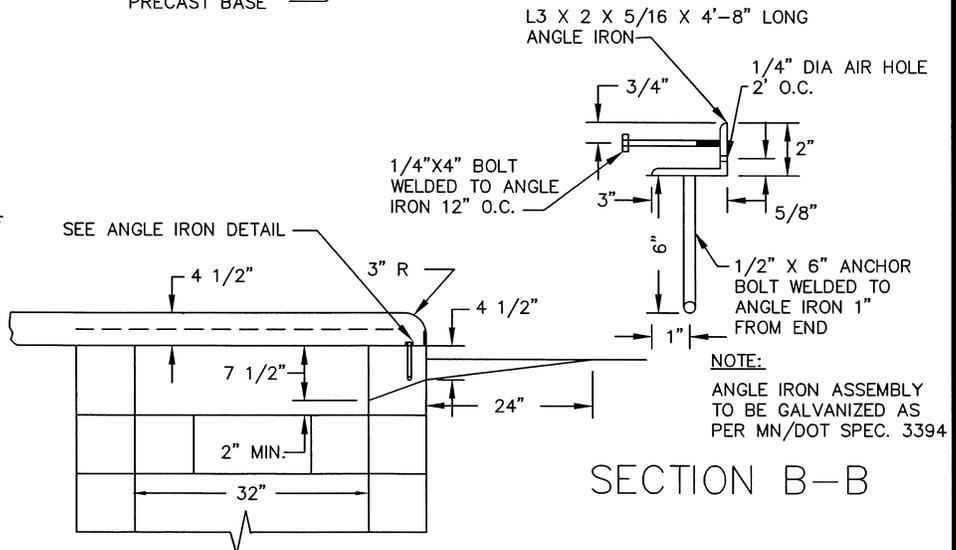

APPROVED *2-19-2026*
Nickel
CITY ENGINEER

CITY OF ST. PAUL
DEPARTMENT OF PUBLIC WORKS
CATCH BASIN, TYPE 2B

Date of
Revision
JAN.
2026

Standard
Plate
No.
2004F